
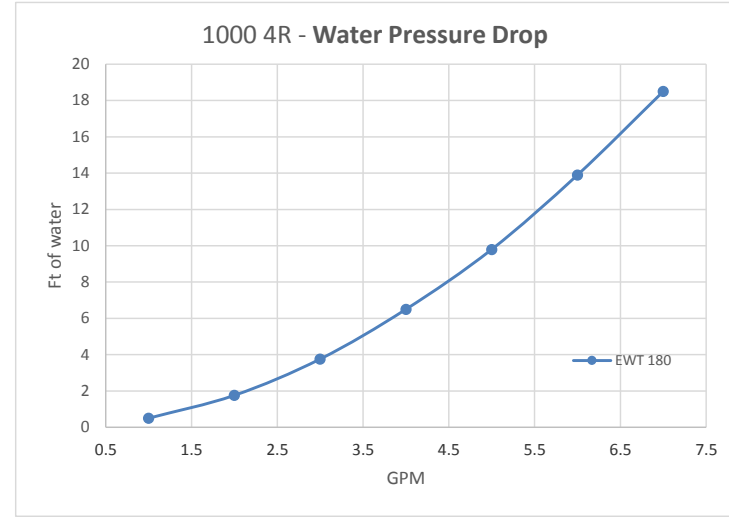


Model: CT 1000 & TCE 1000

4 ROWS - 2 PIPE

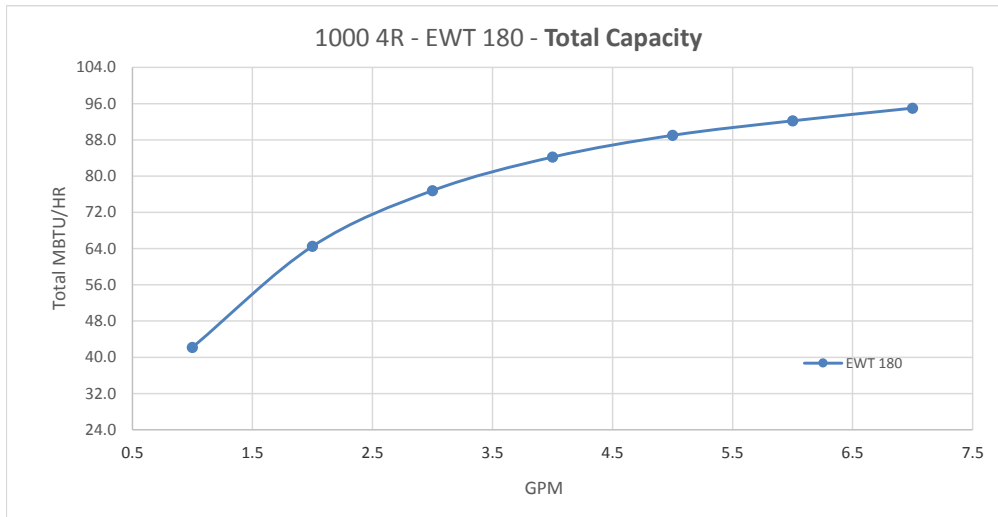

Capacities - MBTUh @ EAT of 70 deg F.

Correction Factor for EWT

120 F = 0.443  
130 F = 0.533  
140 F = 0.626  
160 F = 0.811

Heating Calculations for corrected Water temperatures

$LWT = EWT - \frac{MBTUh}{GPM \times 500}$

$LAT = EAT + \frac{MBTUh}{GPM \times 500}$