
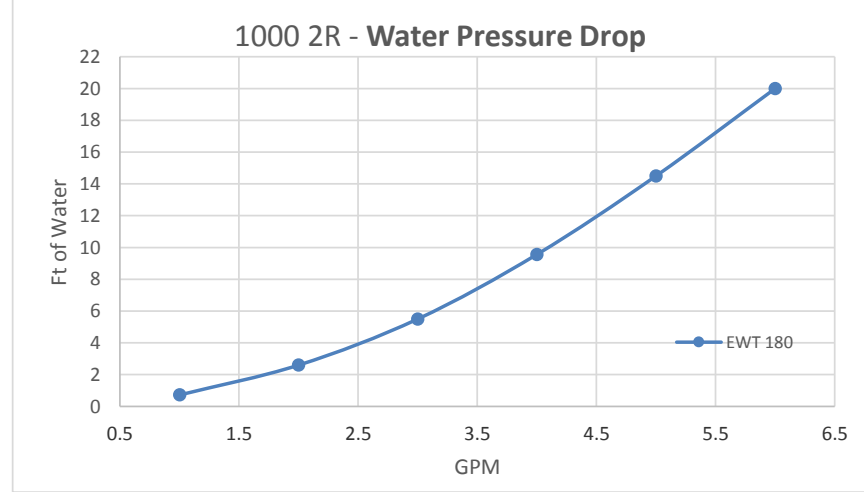
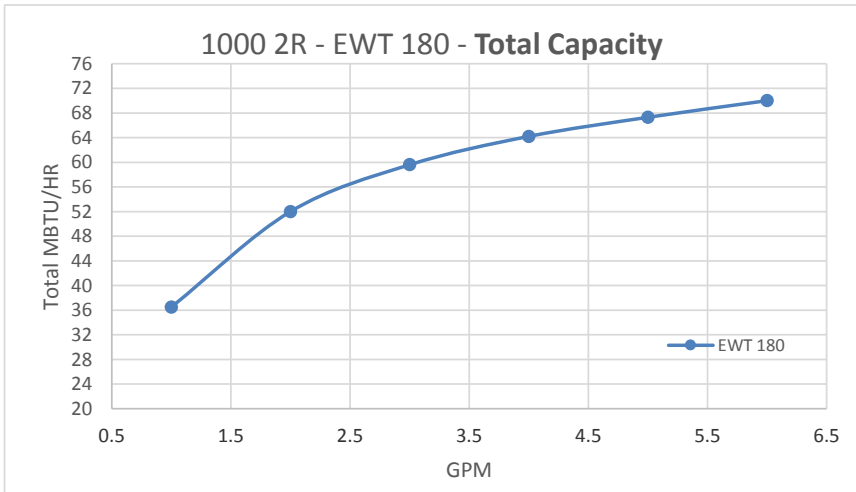
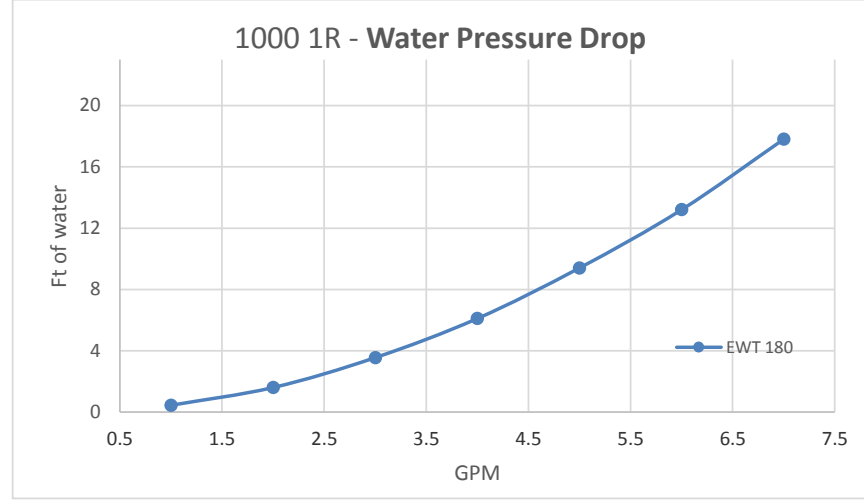


Model: TD 1000

1 & 2 ROWS - 4 PIPE

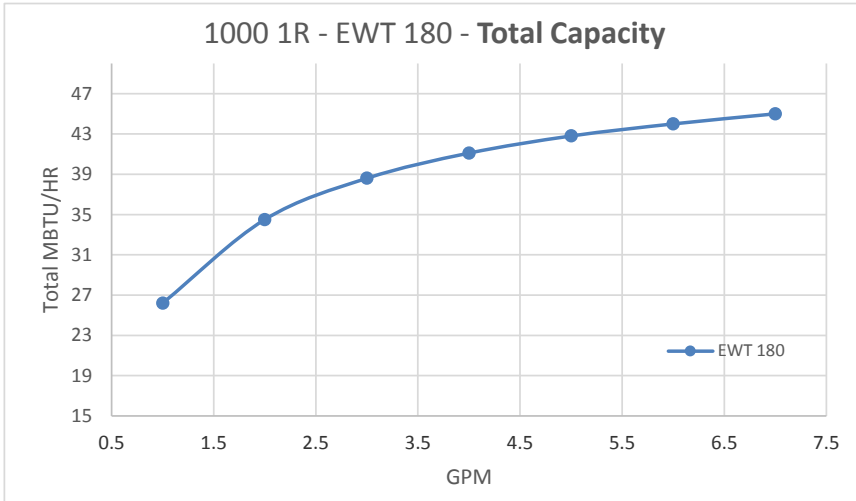

Capacities - MBTUh @ EAT of 70 deg F.

Correction Factor for EWT
 120 F = 0.443
 130 F = 0.533
 140 F = 0.626
 160 F = 0.811

Heating Calculations for corrected Water temperatures

$$LWT = EWT - \frac{MBTUh}{GPM \times 500}$$

$$LAT = EAT + \frac{MBTUh}{CFM \times 1.08}$$