
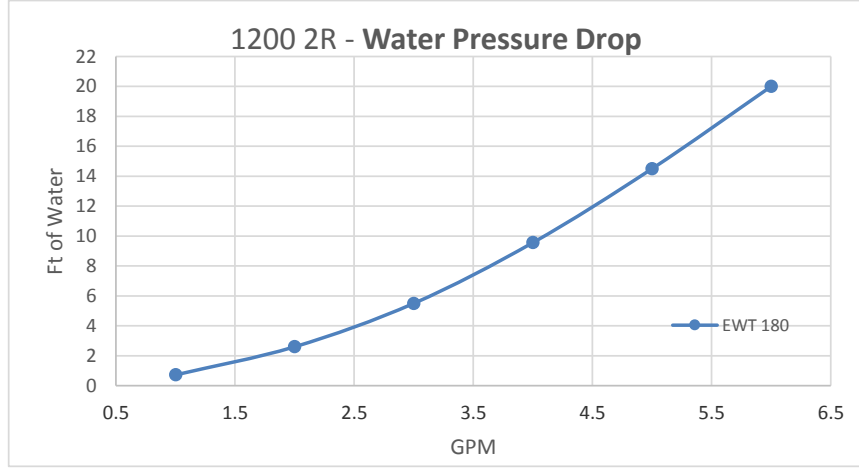
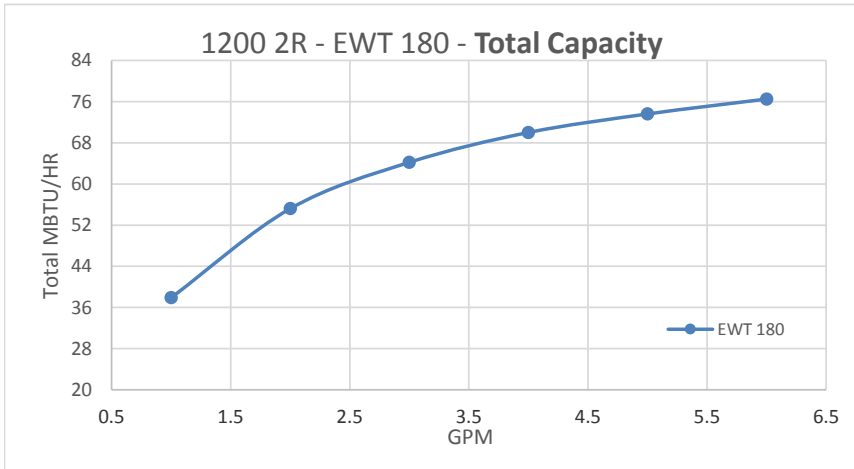
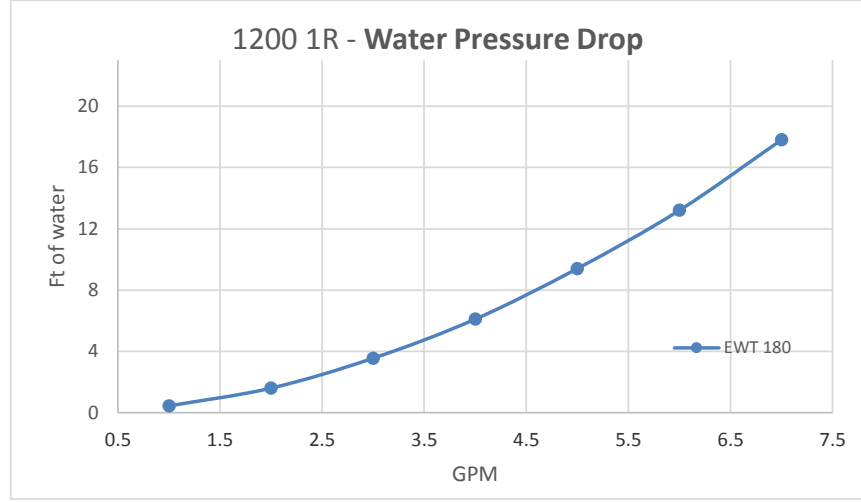


Model: TD 1200

1 & 2 ROWS - 4 PIPE

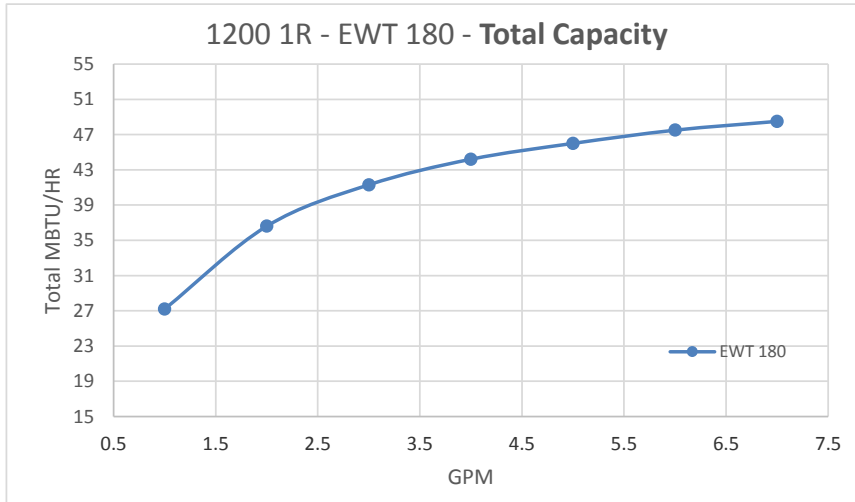

Capacities - MBTUh @ EAT of 70 deg F.

Correction Factor for EWT  
 120 F = 0.443  
 130 F = 0.533  
 140 F = 0.626  
 160 F = 0.811

Heating Calculations for corrected Water temperatures  
 $LWT = EWT - \frac{MBTUh}{GPM \times 500}$   
 $LAT = EAT + \frac{MBTUh}{CFM \times 1.08}$