
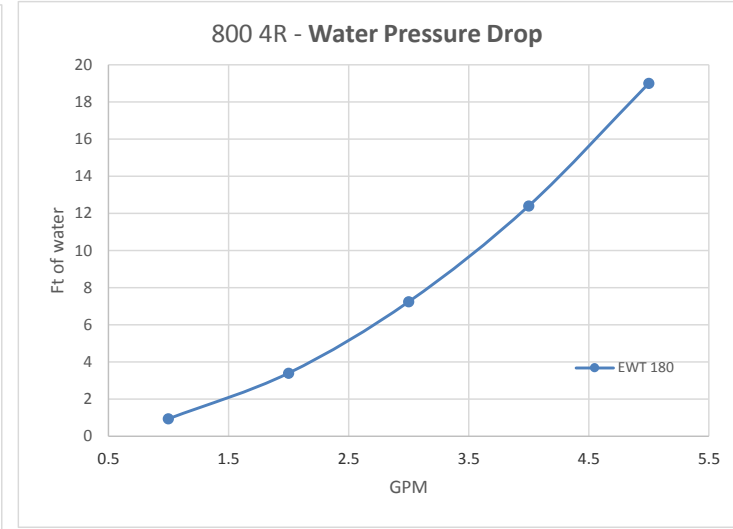


Model: CT 800 & TCE 800

4 ROWS - 2 PIPE

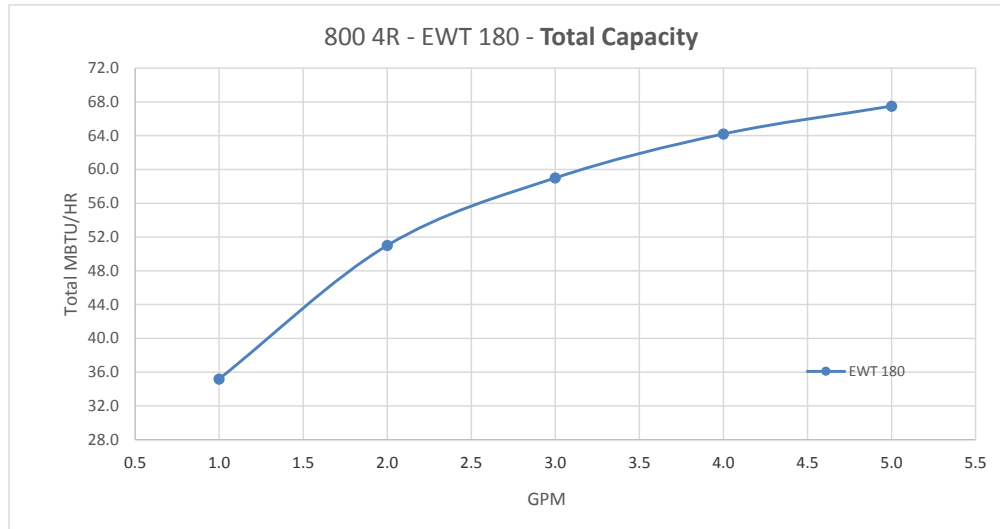

Capacities - MBTUh @ EAT of 70 deg F.

Correction Factor for EWT

120 F = 0.443  
130 F = 0.533  
140 F = 0.626  
160 F = 0.811

Heating Calculations for corrected Water temperatures

$$\text{LWT} = \text{EWT} - \frac{\text{MBTUh}}{\text{GPM} \times 500}$$

$$\text{LAT} = \text{EAT} + \frac{\text{MBTUh}}{\text{GPM} \times 500}$$